

**INSTALLATION INSTRUCTIONS FOR J18 HARNESS KIT
USED WITH LG/LC 036, 048, 060, 072, 074 UNITS**

Shipping and Packing List

Package 1 of 1 contains:

- 1- J18 Harness

⚠ WARNING

Improper installation, adjustment, alteration, service or maintenance can cause property damage, personal injury or loss of life. Installation and service must be performed by a licensed professional HVAC installer or equivalent, service agency, or the gas supplier.

⚠ CAUTION

As with any mechanical equipment, contact with sharp sheet metal edges can result in personal injury. Take care while handling this equipment and wear gloves and protective clothing.

Application

This harness is used when optional power exhaust fans are installed in units which do not have a J18 harness bundled near the top of the filter section. Discard this kit when J18 is present. Refer to 20H48 / 609258-12.

Installation

- 1- Insert harness wires in P4 economizer plug. See figure 1 and 2.

Note - Disconnect J3 unit jack from P4 economizer plug if already connected.

- 2- Insert the J18 power exhaust jack into the side of the economizer as shown in the economizer installation instruction.

- 3- Reconnect P4 and J3.

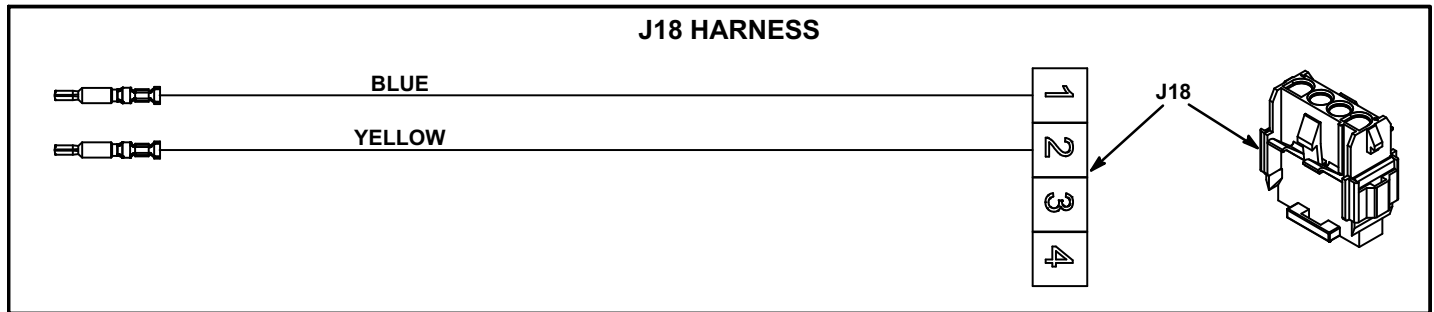


FIGURE 1

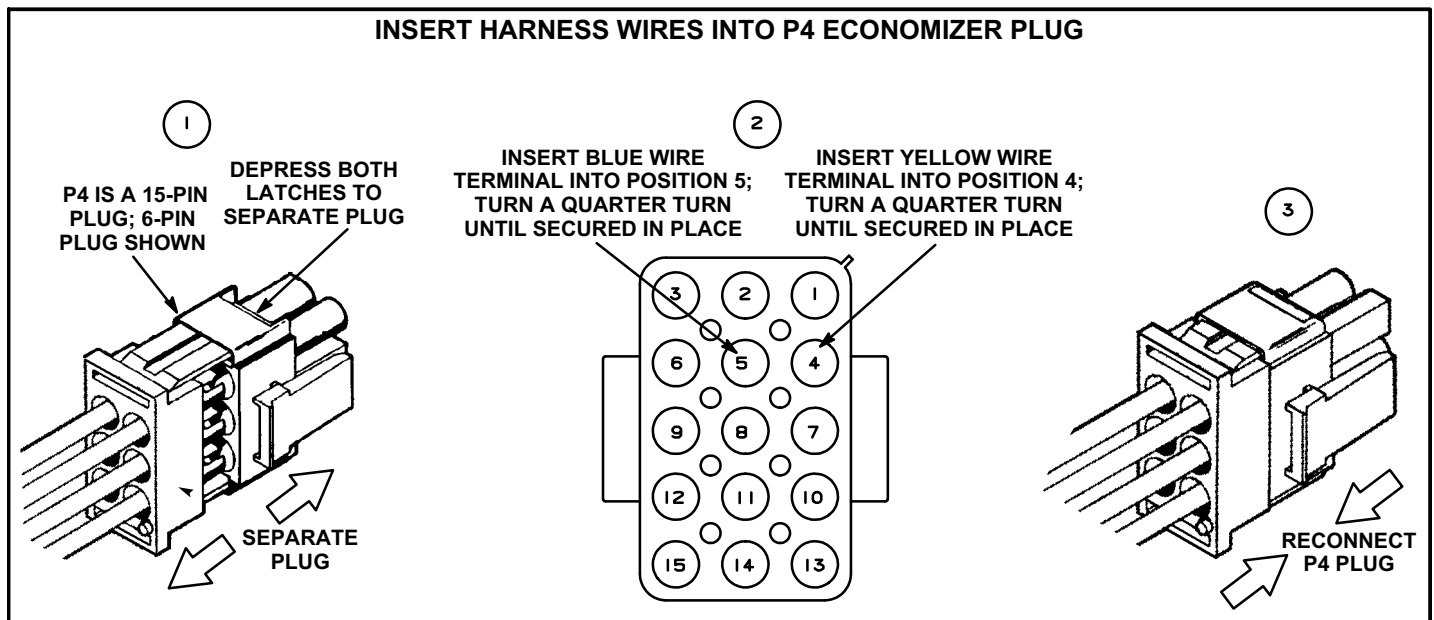


FIGURE 2