



-----POWER ENTRY OPTIONS-----


DISCONNECT SWITCH

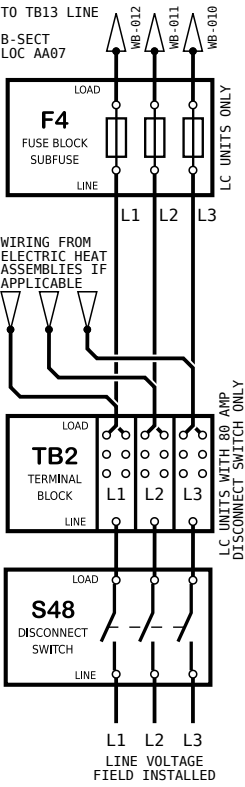

TERMINAL BLOCK

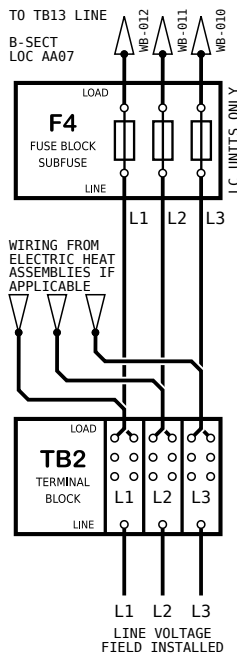


CIRCUIT BREAKER

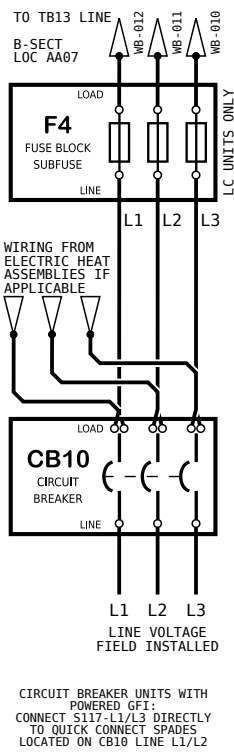

POWERED GFI OPTION - 120V FIELD PROVIDED POWER SUPPLY IS REQUIRED WHEN T29 TRANSFORMER IS NOT PROVIDED.

← DENOTES OPTIONAL COMPONENTS AND WIRING

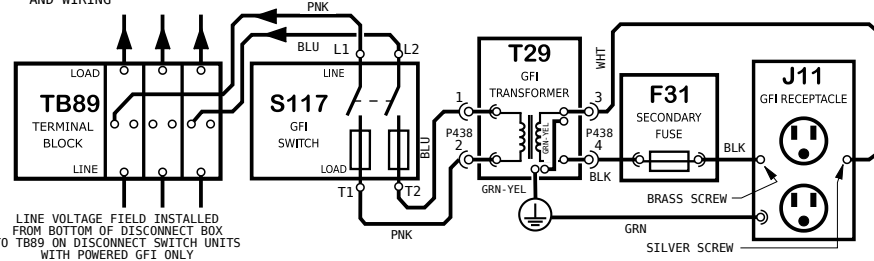


Model: LCT, LGT, LHT, LDT Series RTU
 Power Entry Options 078 - 152
 Voltage: All Voltages
 Supersedes: 538231-01 Form No: 538231-02 Rev: 0



Rev 0

538231-02



REV	EC NO.	DATE	BY	APVD	REVISION NOTE
---	CN-012081N	07-02-2024	FEP	MCF	ORIGINATED AT PD&R CARROLLTON, TX.