

Job:  
 Location:  
 Schedule No.:  
 System Designation:

Engineer:  
 Architect:  
 Location:  
 Date:

For:    Reference    Approval    Review    Construction

## One Way Cassette Indoor Unit

### FEATURES

- Pre Heat Function
- Auto Addressing
- Auto Restart
- Integral Condensate Pump
- Electronic Expansion Valve
- Built-in Four Dry Contact Relays
- Flare Connections
- High-Efficiency DC Motor
- Refrigerant R-410A
- Six capacity sizes from 7,000 to 24,000 Btu/h

### WARRANTY

- 10-year limited warranty.\*See warranty for details.

### SPECIFICATIONS

#### PERFORMANCE

Cooling Capacity <sup>1</sup> (Btu/h)		9000
Heating Capacity <sup>1</sup> (Btu/h)		10000
Airflow (CFM)	High	273
	Medium	226
	Low	180
External Static Pressure (in.w.g.)		0~0.04
Sound (dBA)	High	41.5
	Medium	36.0
	Low	32.5

#### ELECTRICAL DATA

Power Supply (Volts/Phase/Hertz)	208/230V-1Ph-60Hz
Minimum Circuit Ampacity (MCA)	0.29
Max. Overcurrent Protection (MOCP)	15
Cooling Power Input <sup>2</sup> (W)	10
Cooling Rated Current (A)	0.4
Heating Power Input <sup>2</sup> (W)	10
Heating Rated Current (A)	0.4
Indoor Fan Motor Input (W)	10(H:0PA)

#### DIMENSIONS

Unit Dimensions (in)	Height	6
	Width	41-1/2
	Depth	16-3/4
Diffuser Panel Dimensions (in)	Height	1
	Width	46-1/2
	Depth	18-3/8
Liquid Pipe Connection (in)		1/4
Gas Pipe Connection (in)		1/2
Drain Connection (in)		1
Net Weight (lb)		27.1
Shipping Weight (lb)		35.9



### OPTIONAL ACCESSORIES


Non-Programmable Controller	V0STAT54P-3
Programmable Wired Controller	V0STAT51P-3
Infrared Wireless Controller	V0STAT52P-1
Occupancy Sensor	V0SNSR78P-3
HHE Relay Kit	V0CTRL92P-3
Hotel Keycard Interface	V0CTRL88P-1

### NOTES

1. Cooling and Heating capacity data is rated at the following conditions:  
 Cooling: 80°FDB / 67°FWB Indoor, 95°FDB  
 Outdoor Heating: 70°FDB Indoor, 47°FDB / 43°FWB Outdoor.
2. Power Input values are rated at high fan speed.



**DIMENSIONAL DRAWINGS - INCHES (MM)**

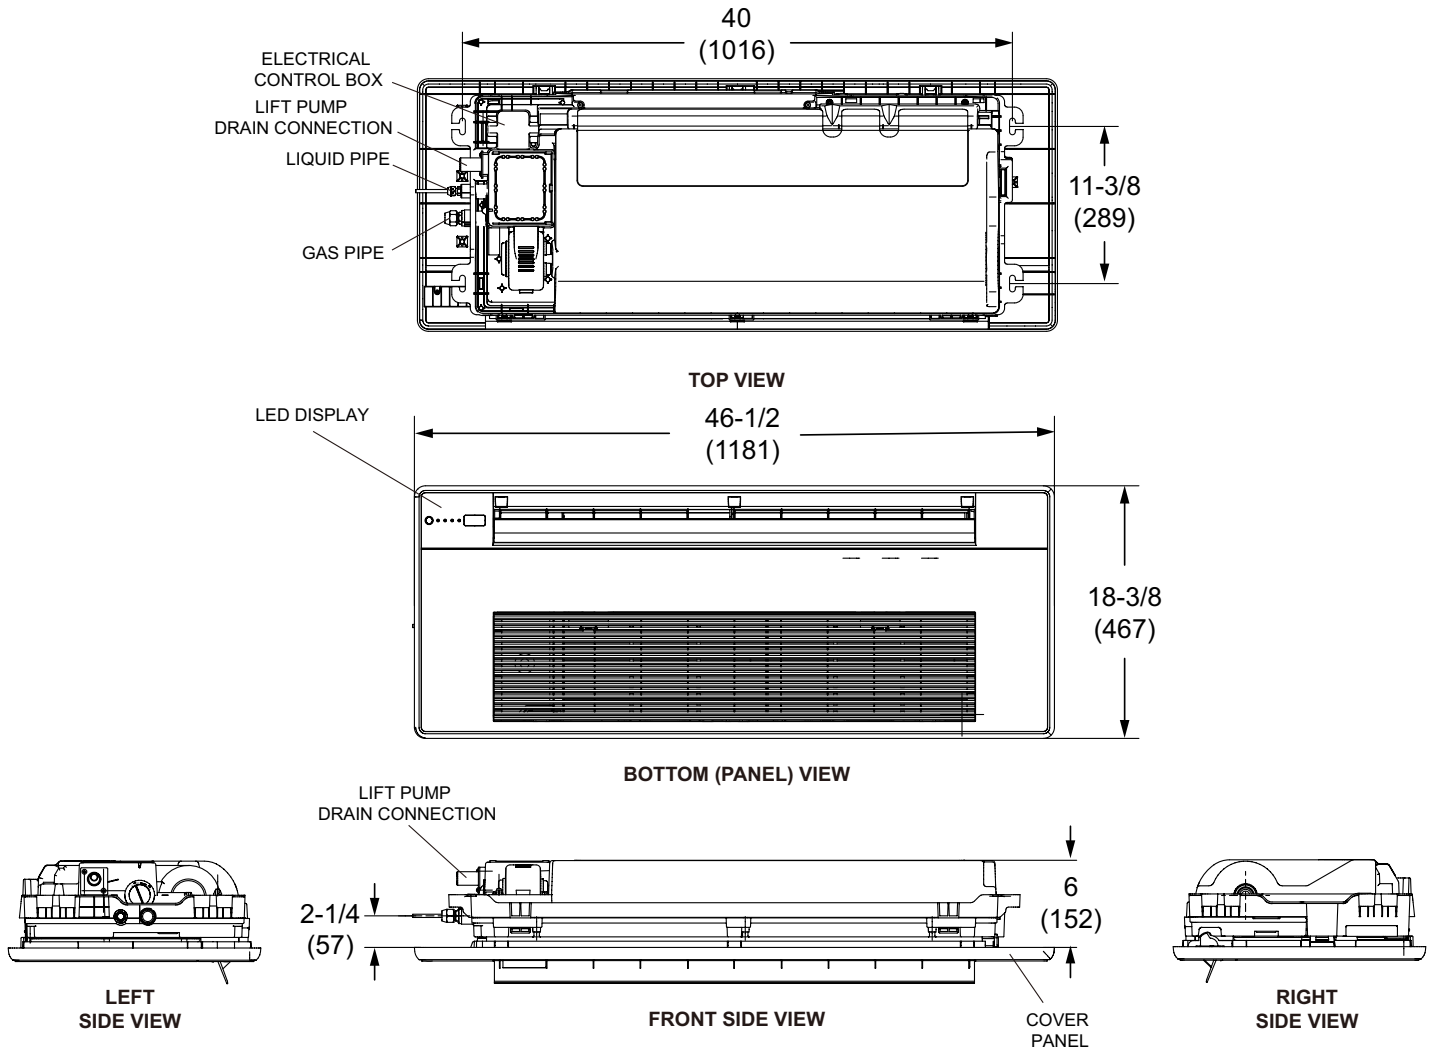

NOTE - Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability. Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency.